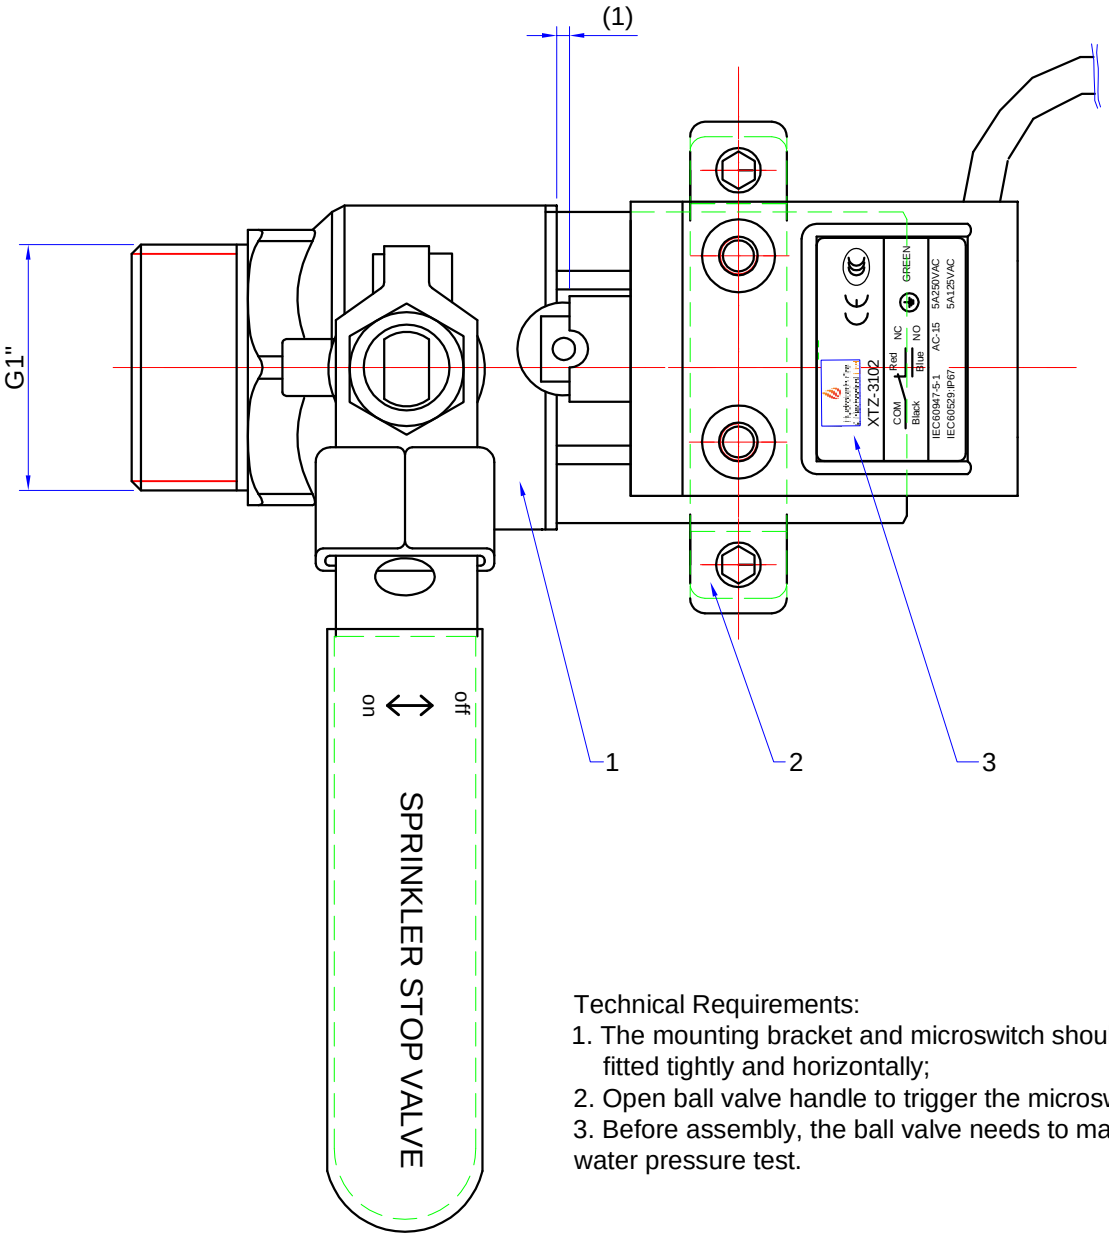


Technical Requirements:

1. The mounting bracket and microswitch should be fitted tightly and horizontally;
2. Open ball valve handle to trigger the microswitch;
3. Before assembly, the ball valve needs to make relevant water pressure test.

No.	Drawing No.	Name	Q'TY	Material	Weigth	Remark
3	DLR01-061-00	Micro switch	1	Assembly		
2	DLR07-024A-00	Mounting bracket suits for 1" micro switch	1	Assembly		
1	DLV05-078-00	G1" female and male threaded ball valve	1	Assembly		

Zone	Revision note	Date	Signature

Drawn			Audit	
Checked			Approved	

1" Monitored Ball Valve

Material.

Assembly

DWG No. DLR60-001-00

Customer or Manu. DWG No. HS047

W.T. 956g | Scale 1:1

Hydrotech