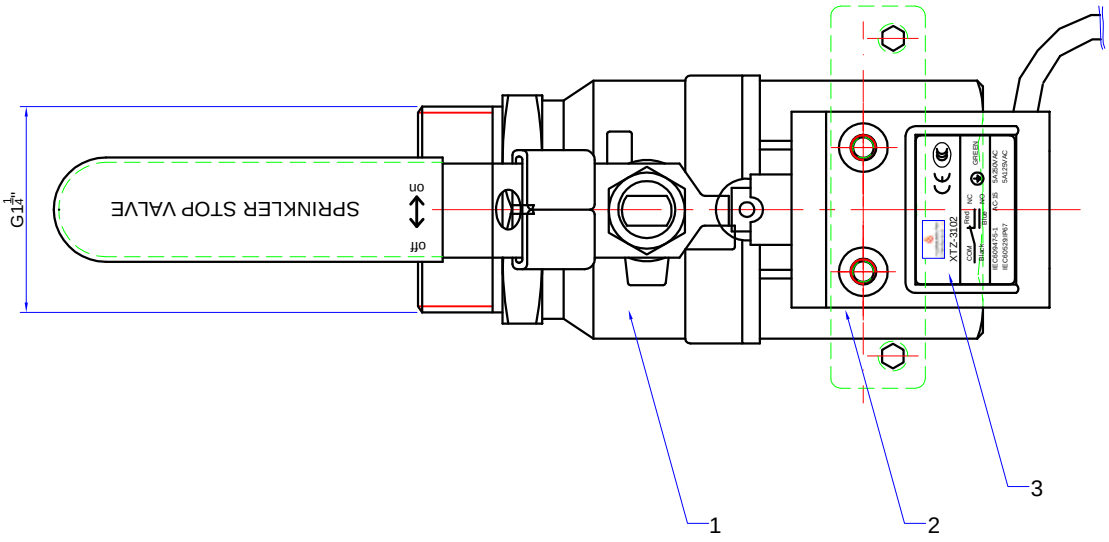


Technical Requirements:
1. The mounting bracket and microswitch should be fitted tightly and horizontally;
2. Open ball valve handle to trigger the microswitch;
3. Before assembly, the ball valve needs to make relevant water pressure test.

No.	Drawing No.	Name	Q'TY	Material	Weigth	Remark
3	DLR01-061-00	Micro switch	1	Assembly		
2	DLR07-025A-00	Mounting bracket suits for 1¼" micro switch	1	Assembly		
1	DLV05-079-00	1.25" female and male threaded ball valve	1	Assembly		

Zone	Revision note	Date	Signature

Drawn			Audit		
Checked			Approved		

1¼" Monitored Ball Valve

Material.
Assembly

DWG No.
DLR60-002-00

Customer or Manu. DWG No.
HS048

W.T. 1250g | Scale 1:1.5

Hydrotech